



RDD310/EH



RDE410/EH

Semi flush-mount room thermostats

RDD310/EH
RDE410/EH

for control of electric floor heating systems and
for hydronic zone control systems

Key features of both types of thermostats:

- Operating voltage AC 230 V
- 2-position control with On/Off control output
- Maximum load 16 A
- Protection class IP31, suitable for installation in wet rooms
- Input for cable temperature sensor NTC 3 k (QAP1030/UFH) for the floor (note: cable temperature sensor must be ordered separately)
- Floor temperature limitation with cable temperature sensor
- Operating modes: Comfort, Economy and Frost Protection
- Minimum and maximum limitation of setpoint setting range
- Backlit white LCD
- Suitable for use with standard conduit boxes in Europe (CEE/VDE) and Asia-Pacific (min. depth 40 mm)

Additional feature of RDE410/EH:

- Auto Timer with 8 programmable time switches

Use

RDD310/EH and RDE410/EH room thermostats are used to control the room temperature in...

- single family and holiday houses,
- multi-family houses with individual heating systems.

For control of the following pieces of equipment:

- Specifically for electric floor heating systems, but also for...
 - thermal valves or zone valves,
 - gas or oil burners (boilers) (an additional relay must be used to connect a potential-free contact),
 - pumps,
 - radiators or convectors.


Functions

- Room temperature control in connection with built-in or external sensor
- Selection of operating mode via operating mode button on the thermostat
- Display of current room temperature or setpoint in °C
- Minimum and maximum limitation of setpoint setting range
- Button lock (automatic or manually)
- Floor temperature limitation with cable temperature sensor
- Backlit white LCD
- Reloading factory settings for commissioning and control parameters
- Auto Timer: 8 programmable 7-day time switches to switch between Comfort and Economy mode (RDE410/EH only)

Temperature control

The thermostat acquires the room temperature with its built-in sensor and maintains the setpoint by delivering control commands. The switching differential is 1 K.

Function diagram

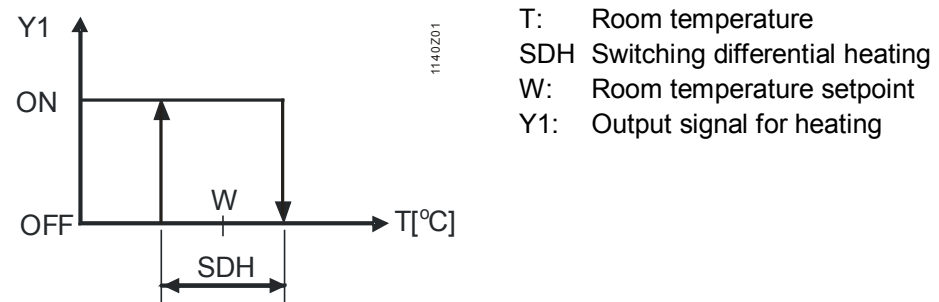

Floor heating application

The factory setting for this function is "Off" and must be set to "On" if floor heating is used. This function is activated via parameter P38.


The installer must select the capacity of the heating system (in kW) via parameter P45 during commissioning.

The cable temperature sensor is connected to input X1, M and acquires the floor temperature. If the floor temperature exceeds the parameterized limit xx °C (P38 = 1, P51 = xx °C), the heating system is turned off until the floor temperature returns to a level below the parameterized limit. Typical applications are rooms (dry floor).

If the application does not require floor temperature limitation but instead uses the external sensor for room temperature display and control, the parameters will have to be set as follows: P38 = 1, P51 = Off. Typical applications are bathrooms (wet floor) where a constant floor temperature is required.

It is not recommended to have **only** a built-in room sensor for floor heating since in that case there is a potential risk of overheating.


Operating modes

The operating mode is selected via operating mode button . The respective setpoint maintains the room temperature at the desired level. The following operating modes are available:

Comfort mode

In Comfort mode, the thermostat maintains the setpoint which can be adjusted via the +/- buttons.





Economy mode

Economy mode helps save energy. It is selected via operating mode button  if parameter P02 is set accordingly.

Frost Protection mode

In Frost Protection mode, the system is protected against frost (factory setting = 8 °C).

Auto Timer mode (only with RDE410/EH)

In Auto Timer mode , the thermostat switches automatically between Comfort and Economy mode according to the 8 programmed time switches. The display shows Auto Timer mode symbol  along with the symbol for the current operating mode (Comfort  or Economy ).

Setpoints

Comfort mode

The Comfort setpoint is adjusted with the +/- buttons. Factory setting for the Comfort basic setpoint is 20 °C, which can be changed via parameter P08. The Comfort basic setpoint is used in conjunction with the "Temporary setpoint" function.

Setpoint limitation

The setpoint setting range can be limited to a minimum (parameter P09) and maximum (parameter P10).

Temporary setpoint

If "Temporary setpoint" is enabled via parameter P69, the setpoint adjusted via the +/- buttons is set back to the Comfort basic setpoint (parameter P08) when the operating mode changes.

Economy mode 

Control parameter P11 is used to adjust the Economy setpoint (factory setting = 16 °C).

Frost Protection mode 

Control parameter P65 is used to adjust the setpoint for Frost Protection mode (factory setting = 8 °C).

Caution 

If a setpoint is set to "Off", the thermostat does not maintain the setpoint in the respective operating mode, which means no protective heating function, resulting in risk of frost.

Type summary

Product no. (ASN)	Stock no.	Features
RDD310/EH	S55770-T296	Mains-powered AC 230 V
RDE410/EH	S55770-T333	Mains-powered AC 230 V with Auto Timer
QAP1030/UFH	S55770-S289	Cable temperature sensor NTC 3 k, cable length 4 m

Ordering







When ordering, please indicate the product no., stock no. and description.

Example:

Product no. (ASN)	Stock no.	Description
RDD310/EH	S55770-T296	Room thermostat

Cable temperature sensor, electric floor mat, valves and actuators must be ordered separately.

Equipment combinations


	Description		Product no.	Data Sheet
Sensors	Cable temperature sensor, cable length 4 m		QAP1030/UFH	1854
On/Off actuators	Electromotoric actuators with On/Off valve (only available in AP, UAE, SA and IN)		MVI../MXI..	A6V11251892
	Electromotoric On/Off actuators		SFA21..	4863
	Thermal actuators (for radiator valves)		STA23..	4884
	Thermal actuators (for small valves 2.5 mm)		STP23..	4884
	Zone valve actuators (only available in AP, UAE, SA and IN)		SUA21..	4830

The room thermostat consists of 2 parts:

- Front panel which accommodates the electronics, the operating elements and the built-in room temperature sensor
- Mounting base with power electronics


The base fits on the conduit box. The front panel slides in the mounting base and snaps on.

RDD310/EH

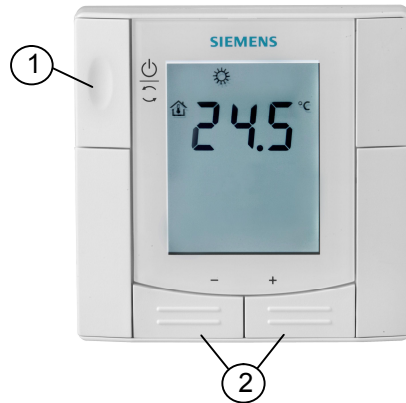

1. Operating mode button/Frost Protection
2. Button for adjustment of setpoint and control parameters


RDE410/EH

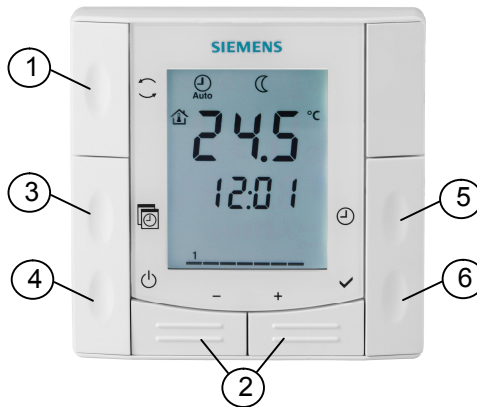

1. Operating mode button
2. Button for adjustment of setpoints, control parameters and time of day
3. Button for Auto Timer program
4. Button for Frost Protection
5. Button for setting the time of day and the weekday
6. Button for confirmation

Display

The digital display shows the acquired room temperature or the setpoint for the current operating mode, selectable via parameter P06. The factory setting displays the current room temperature.

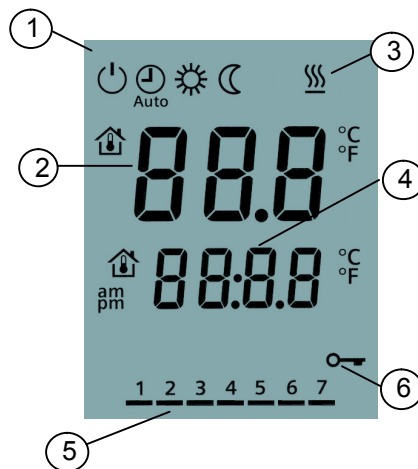


1. Operating mode:
 - ⏻ Frost Protection
 - 🕒 Auto Timer
 - ☀️ Comfort
 - 🌙 Economy
2. Room temperature, setpoints and control parameters
 - 🏠 Symbol for display of the current room temperature
3. 🌊 Heating On
4. Current time of day *)
5. Weekday 1...7 *)
 - 1 = Monday / 7 = Sunday
6. Button lock active

*) RDE410/EH only

Mounting and installation notes

Mount the room thermostat on a recessed rectangular conduit box. Do not mount it in niches or bookshelves, not behind curtains, not above or near heat sources, and not exposed to direct solar radiation. Mount it about 1.5 m above the floor.

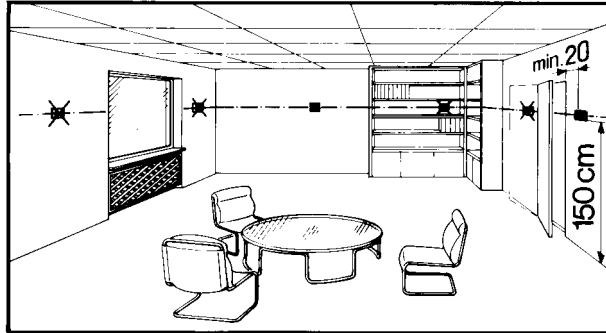

Wiring

See Mounting Instructions CB1M1440xx enclosed with the thermostat.

- ⚠ • Ensure that wiring, protection and earthing comply with local regulations
- ⚠ • Correctly size the cables to the thermostat and the floor heating system
- ⚠ • If the thermostat cannot accommodate all cables, power must be fed to the system via an external terminal block
- ⚠ • The AC 230 V mains supply line must have a circuit breaker with a rated current of no more than 16 A
- ⚠ • Disconnect from power supply before removing the unit from the wall
- ⚠ • External inputs X1, M may carry mains potential. The sensor cable must be carefully installed before applying power to the thermostat




Commissioning notes

- | | |
|---------------------------------------|--|
| Floor heating system | <ul style="list-style-type: none">• It is mandatory to select the approximate load of the floor heating system via parameter P45 during commissioning. If not sure, the supplier of the floor heating system should be consulted |
| Floor temperature limitation | <ul style="list-style-type: none">• For limitation of the floor temperature via parameter P51, contact the floor supplier. Be aware that the floor temperature is acquired where the sensor head is located |
| Sensor calibration | <ul style="list-style-type: none">• If the temperature shown on the display does not agree with the room temperature effectively measured (after at least one hour of operation), the temperature sensor can be recalibrated. For that purpose, adjust parameter P05 |
| Setpoint and setting range limitation | <ul style="list-style-type: none">• We recommend to review the setpoints and the setpoint setting range (parameters P08...P11) and change them as needed to achieve maximum comfort and to save energy |
| Resetting parameters | <ul style="list-style-type: none">• The factory setting for the control parameters can be reloaded via parameter P71 by changing the value to "On" and confirming by pressing buttons + and – simultaneously. The display shows "888" during reloading |

Commissioning notes

After power is applied, the thermostat carries out a reset during which all LCD segments flash, indicating that the reset was correctly made. After the reset, which takes about 3 seconds, the thermostat is ready for commissioning by qualified HVAC personnel. The control parameters of the thermostat can be set to ensure optimum performance of the entire system (see below).

Control parameters

#	Parameter	Factory setting	Setting range
Service level			
P02	Selection of operating mode via operating mode button 	1 = Comfort – Frost Protection	RDD310/EH: 1 = Comfort - Frost Protection 2 = Comfort - Economy - Frost Protection RDE410/EH: 1 = Auto - Comfort - Frost Protection 2 = Auto - Comfort - Economy - Frost Protection
P05	Temperature sensor calibration	0.0 °C	-3...3 °C
P06	Standard temperature display	0 = Room temperature	0 = Room temperature 1 = Setpoint
P08	Comfort basic setpoint	20 °C	5...40 °C
P09	Min. setpoint limitation in Comfort mode ($W_{min_{Comf}}$)	5 °C	5...40 °C
P10	Max. setpoint limitation in Comfort mode ($W_{max_{Comf}}$)	35 °C	5...40 °C
P11	Heating setpoint in Economy mode	16 °C	Off, 5...18 °C
P14	Button lock (press operating mode button  for 3 seconds to lock or unlock)	0 = Disabled	0 = Disabled 1 = Auto lock 2 = Manual lock
Expert level			
P30	Switching differential in heating mode	1 K	0.5...6 K
P38	External input	0	0 = No input 1 = External sensor input
P45	Heating system load in kW	2.8 kW	0...3.6 kW
P51	Floor heating temperature limit	Off	Off, 10...60 °C
P65	Setpoint of heating in Frost Protection mode  ($W_{heat_{Stb}}$)	8 °C	Off, 5...18 °C
P69	Temporary setpoint in Comfort mode	Off	Off = Disabled On = Enabled
P71	Reloading factory settings Set value to "On" and confirm by pressing buttons + and –	Off	Off = Idle On = Reset
Diagnostics and test			
d02	Status X1	Diagnostics	0...xx °C = Measured temperature
d07	Software version information	No adjustment	Ux.x

Parameter settings

Parameter settings at service and expert level:

The parameters are divided into "Service level" and "Expert level". The parameter setting mode can be entered as follows: Set the thermostat to "Off/Frost Protection" (U).

Service level only
(P02...P14)

- Press buttons + and – simultaneously for 3 seconds. Release them and, within 2 seconds, press button + for 7 seconds. Parameters P02...P14 can now be adjusted (service level)

Expert level plus service level (all parameters P02...P71)

- Press buttons + and – simultaneously for 3 seconds. Release them and, within 2 seconds, press button – for 7 seconds. Parameters P02...P71 can now be adjusted (expert level)

In parameter setting mode, the parameters can be readjusted as follows:

1. Select the required parameter by repeatedly pressing button + or –.
2. When pressing buttons + and – simultaneously, the current value of the selected parameter starts to flash; change it by repeatedly pressing button + or –.
3. When you again press buttons + and – simultaneously, the next parameter is displayed.
4. Repeat steps 1 to 3 to display and change additional parameters.
5. At the service or expert level: 10 seconds after the last display or setting, all changes are stored and the thermostat will leave parameter setting mode. At the expert level: Press + or – until "End" is displayed. Then, press + and – simultaneously to save the change and exit parameter setting mode.

Disposal



The device is considered an electronic device for disposal in terms of the European Directive 2012/19/EU and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.


Technical data

⚠ Power supply	Operating voltage	AC 230 V + 10/-15%
	Frequency	50 Hz
	Power consumption	Max. 4 VA
Outputs	Control output Y1-N1 (NO)	AC 230 V
	Rating	Max. 16 (8) A
	External protection for incoming cable	
	Circuit breaker	Max. 16 A
	Circuit breaker tripping characteristic	Type B, C or D to EN 60898 and EN 60947
Inputs	External sensor input (X1-M)	
	Type	NTC 3 k
	Temperature range	0...70 °C
	Cable length	Max. 80 m


Operating data	Switching differential (adjustable)	
	Heating mode	(P30) 1 K (0.5...6 K)
	Setpoint setting and range	
	☀ Comfort mode	(P08) 20 °C (5...40 °C)
	☾ Economy mode	(P11) 16 °C (Off, 5...18 °C)
	⏻ Frost Protection	(P65) 8 °C (Off, 5...18 °C)
	Floor temperature limitation setting range	
	Factory setting	(P38) Off (limitation function not active)
	Built-in room temperature sensor	
	Measuring range	0...49 °C
Accuracy at 25 °C	<±0.5 K	
Temperature calibration range	±3.0 K	
Environmental conditions	Settings and display resolution	
	Setpoints	0.5 °C
	Current temperature value displayed	0.5 °C
	Operation	
	Climatic conditions	As per IEC 60721-3-3
	Temperature	Class 3K5
	Humidity	0...50 °C
	Transport	
	Climatic conditions	<95% r.h.
	Temperature	As per IEC 60721-3-2
Humidity	Class 2K3	
Mechanical conditions	-25...60 °C	
Storage		
Climatic conditions	Class 1K3	
Temperature	-25...60 °C	
Humidity	<95% r.h.	
Standards and directives	EU Conformity (CE)	
	RCM conformity	
	Protection class	
	Pollution class	
	Degree of protection of housing	
	Environmental compatibility	
Eco design and labelling directives	The product environmental declaration CE1E1440en ^{*)} contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).	
	Based on EU Regulation 813/2013 (Eco design directive) and 811/2013 (Labelling directive) concerning space heaters, combination heaters, the following classes apply:	
General	Application with On/Off operation of a heater	Class I value 1%
	Connection terminals	Solid wires 1 x 2.5 mm ²
	Weight	0.149 kg
	Color of housing front	RAL 9003 white

^{*)} The documents can be downloaded from <http://siemens.com/bt/download>.


Connection diagrams

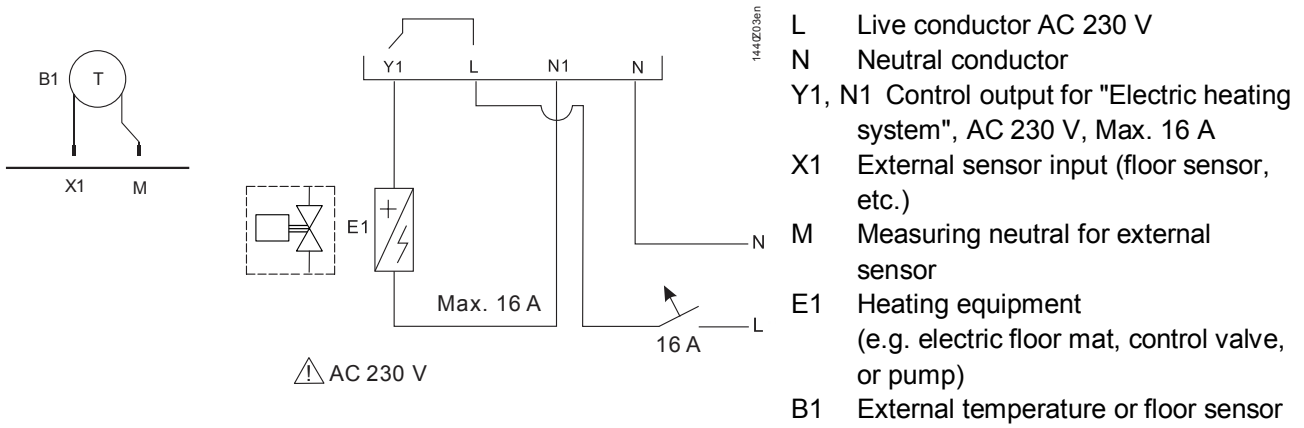


Application examples

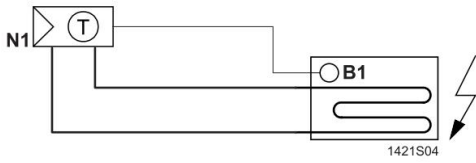


Room thermostat for control of electric floor heating systems. Floor temperature limitation with cable temperature sensor

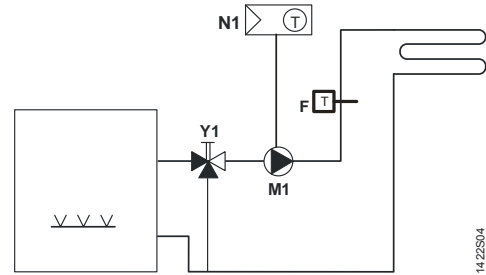

Room thermostat with direct control of hydronic floor heating system

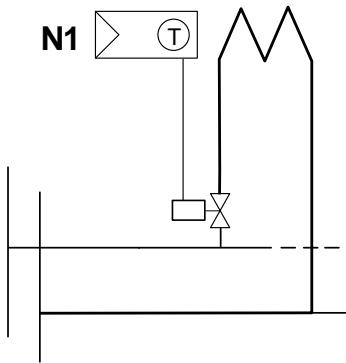

Room thermostat for a hydronic radiator or floor heating system

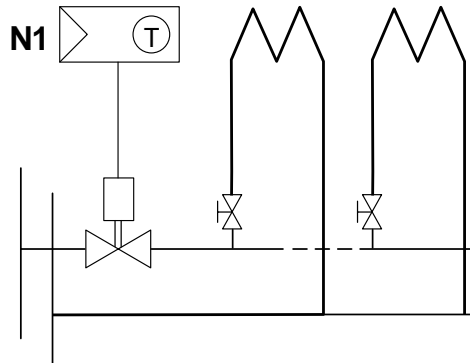


Room thermostat for a hydronic zone control system (radiator/floor heating)

B1 Floor temperature sensor
M1 Circulating pump

N1 Room thermostat RDD310/EH, RDE410/EH
Y1 3-port mixing valve with manual adjustment
F Thermal reset limit thermostat

Dimensions (mm)

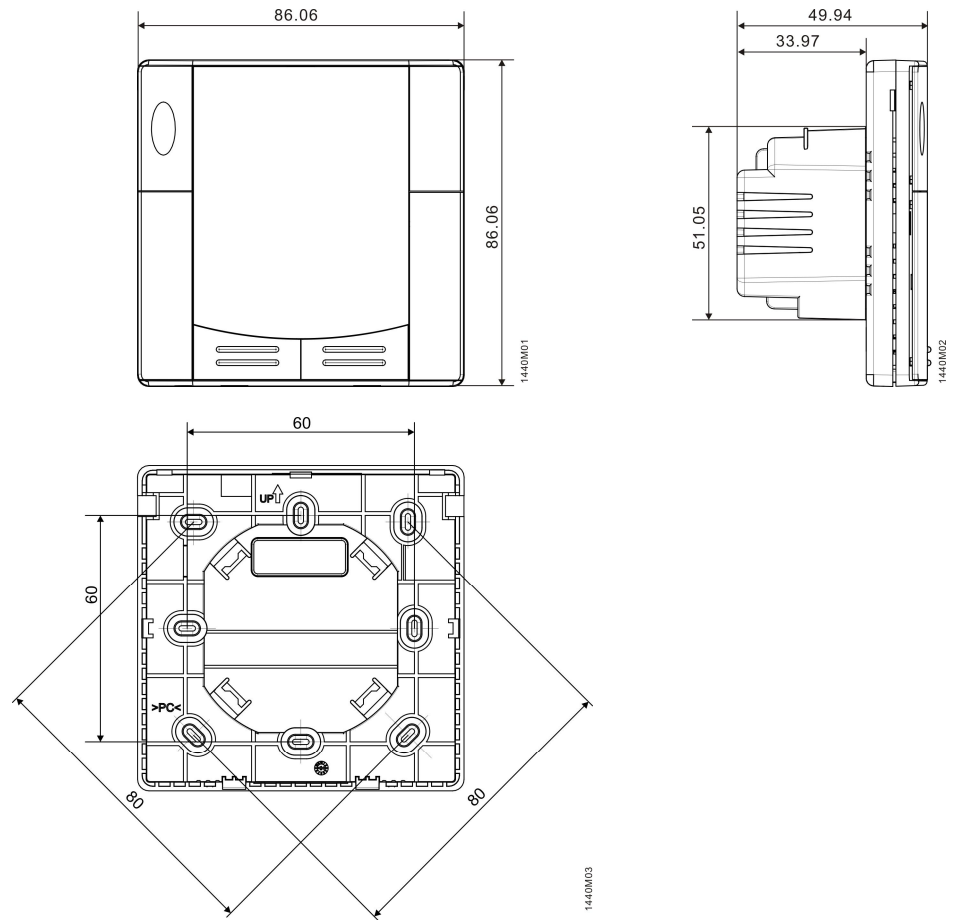

Remarks

Heating:

Because of the unavoidable self heating effects of the electrical current, any loads of more than 10 Amperes connected to the unit can influence the control behavior and temperature accuracy in a negative way. So since this is an electric floor heating product, therefore it is always a must to use an external floor temperature sensor.

Issued by
Siemens Switzerland Ltd.
Building Technologies Division
International Headquarters
Theilerstrasse 1a
CH-6300 Zug
Tel. +41 58 724 2424
www.siemens.com/buildingtechnologies

12 / 12

© Siemens Switzerland Ltd, 2013 - 2018
Technical specifications and availability subject to change without notice.